


WIRING INSTALLATIONS MUST MEET LOCAL GUIDELINES, IF APPLICABLE, SET FORTH BY CITY, COUNTY, OR OTHER GOVERNING ENTITY IN THE EVENT THESE REQUIREMENTS ARE MORE STRINGENT THAN BLUEBONNET SPECIFICATIONS.

- Notes:
- Covers on circuit breaker compartments must be removable without disturbing meters.
 - Meter socket components must be readily accessible and removable for maintenance.
 - Weatherproof fittings required.
 - Wire sized to total disconnect sizes.
 - Neutral(s) may be reduced no more than two sizes on residential application. No reduction of the neutral(s) is allowed on commercial application.
 - For all URD jobs, electricians should call in for locate before digging to Bluebonnet equipment.

- Bluebonnet will complete wiring into transformer. Have sufficient amount of wire for termination.
- Meter loop must remain unenclosed on exterior of structure.
- If a main disconnect module is used, its cover must have provisions for a standard Bluebonnet padlock.
- All secondary connections made by Bluebonnet.
- Member/Electrician shall coordinate with Bluebonnet personal to install all conduit and the pulling of the secondary wire to the transformer. Member/Electrician shall notify Bluebonnet 48 hours in advance to schedule a time/date to perform the work.
- If additional trips are made to the site by Bluebonnet personnel, applicable fees maybe applied.
- #6 Solid, Bare ground copper wire and clamp attached to Bluebonnet's pole ground.
- No more than one disconnect per enclosure.
- The main electrical disconnect for each electrical service shall be installed on the exterior of the building in a location approved by Bluebonnet Electric Cooperative.

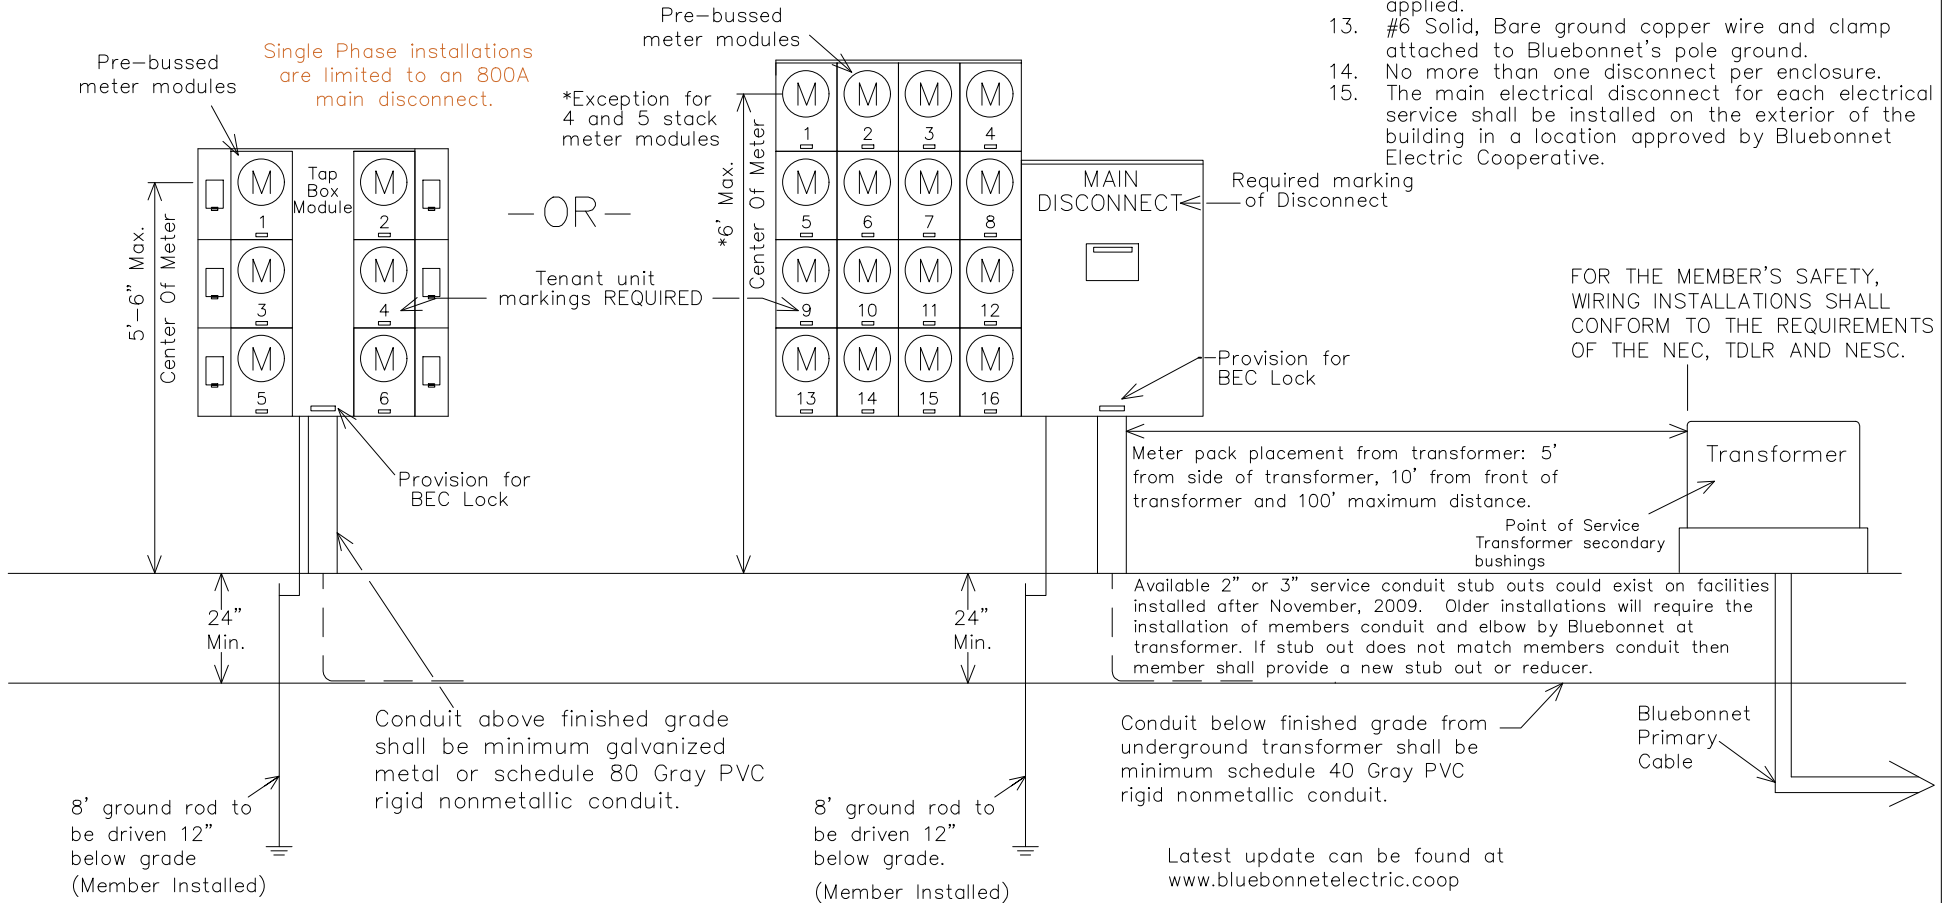

1Ø 60-200 AMP UNDERGROUND MULTI-PACK METERS ON BUILDING	
DATE	REVISIONS
11-20-19	Added Solid Copper Note.
11-04-21	Added Main Breaker Note.

Drawn By :	BS
Scale :	NONE

Checked By :	MS COMMITTEE
Date :	11-04-2021

Approved By :	MS COMMITTEE
	MS-207