


\* WIRING INSTALLATIONS MUST MEET LOCAL GUIDELINES, IF APPLICABLE, SET FORTH BY CITY, COUNTY, OR OTHER GOVERNING ENTITY IN THE EVENT THESE REQUIREMENTS ARE MORE STRINGENT THAN BLUEBONNET SPECIFICATIONS. \*

NOTES:

1. Weatherproof fittings required.
2. Wire sized to total disconnect size.
3. Neutral may only be reduced two sizes on residential application. No reduction of the neutral is allowed on commercial application.
4. Meter assembly must remain unenclosed on exterior of structure.
5. Meter assembly cannot be mounted on a mobile home.
6. Member's equipment shall not be attached to Bluebonnet's equipment except for the riser.
7. #6 solid, bare ground copper wire and clamp attached to Bluebonnet's pole ground.
8. The main electrical disconnect for each electrical service shall be installed on the exterior of the building in a location approved by Bluebonnet Electric Cooperative.

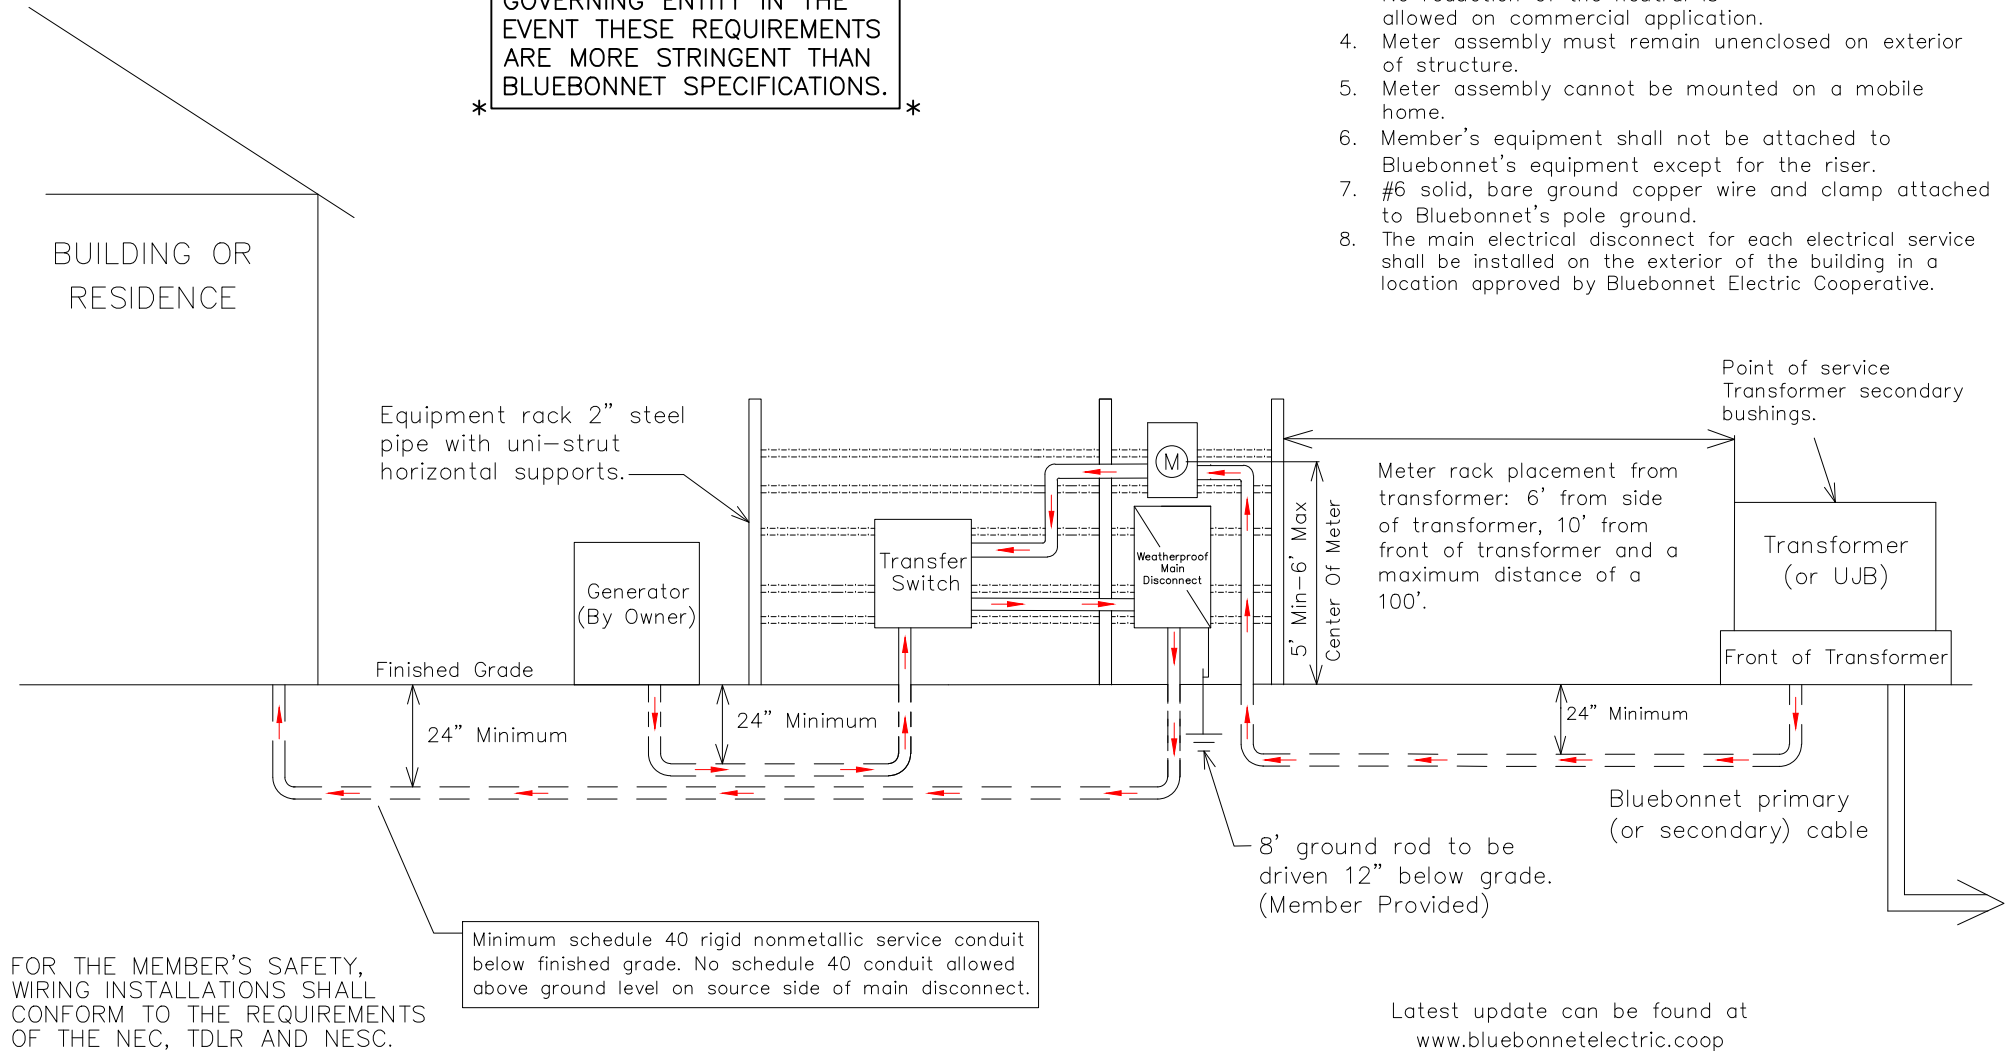

FOR THE MEMBER'S SAFETY, WIRING INSTALLATIONS SHALL CONFORM TO THE REQUIREMENTS OF THE NEC, TDLR AND NESC.

Latest update can be found at [www.bluebonnetelectric.coop](http://www.bluebonnetelectric.coop)



60-200 AMP 1Ø Existing URD SERVICE TO A UNDERGROUND STANDBY GENERATOR SYSTEM WITH METER ON RACK OR BUILDING.	
DATE	REVISIONS
11-15-2016	ADDED FLOW ARROWS.
11-20-2019	ADDED SOLID COPPER NOTE.

Drawn By :	Checked By :	Approved By :
JW	MS COMMITTEE	MS COMMITTEE
Scale :	Date :	
NONE	11-04-2021	MS-408